



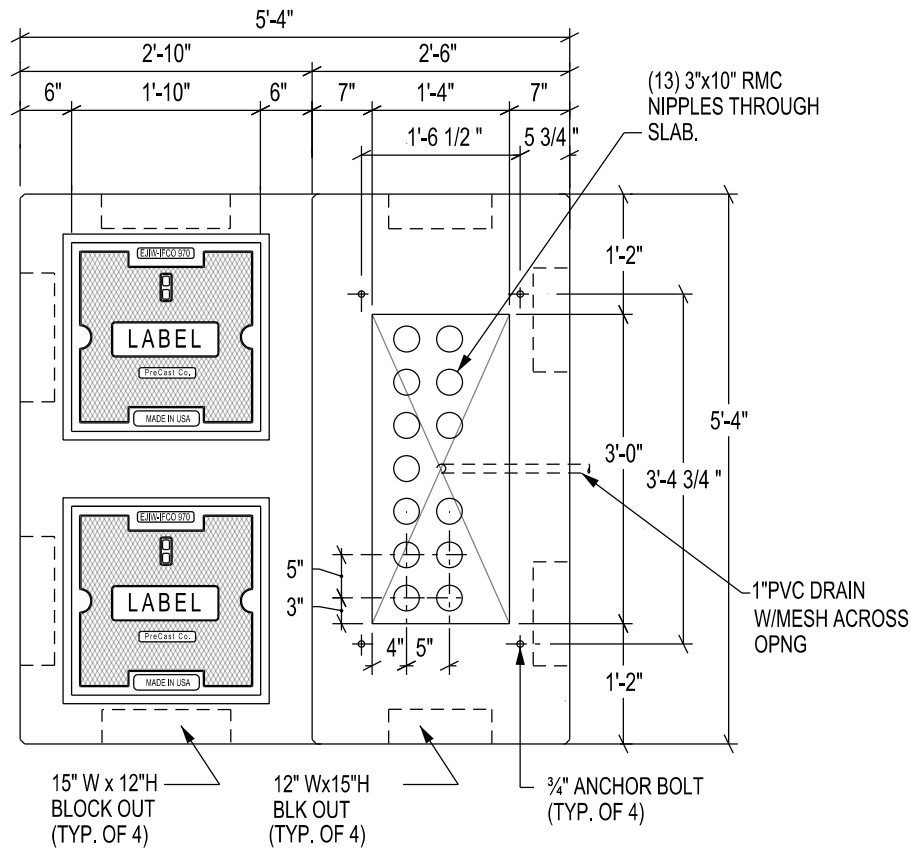

PLAN VIEW

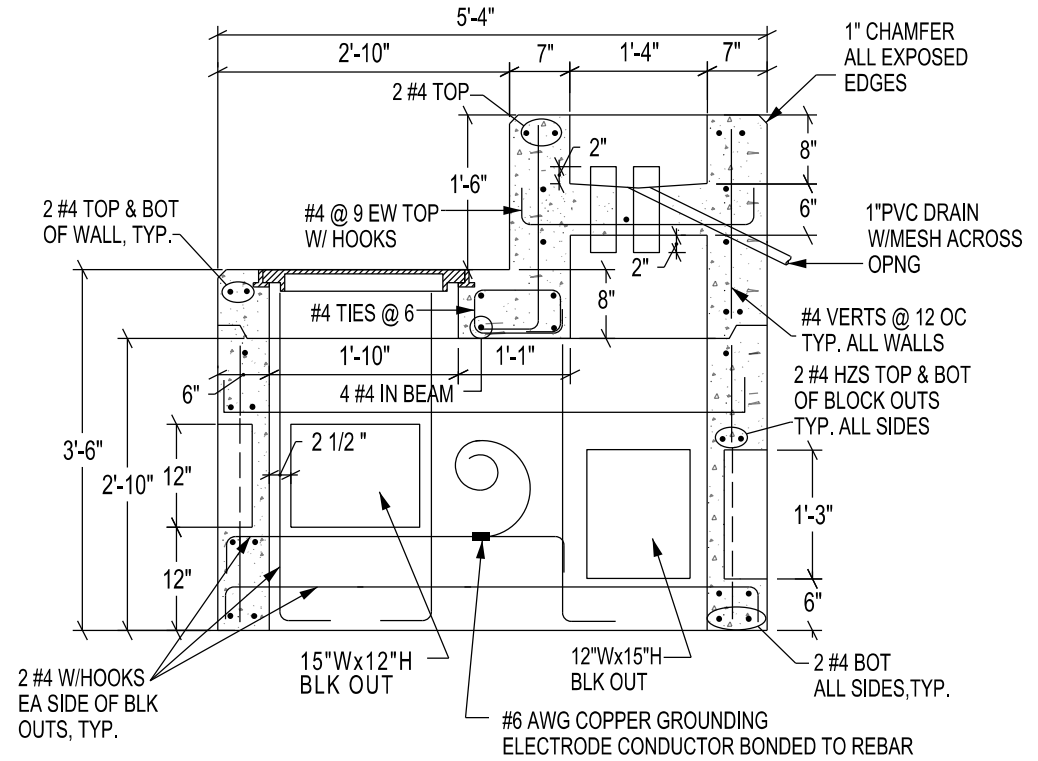

SECTION

NOTES:

1. ALL REBAR SHALL BE ASTM A615 GR.60
2. CONCRETE  $f_c = 6,500$  PSI
3. ANCHOR BOLTS 1 1/2" ABOVE SURFACE
4. 1" CHAMFER ALL EXPOSED EDGES
5. INSTALL #6 AWG COPPER GROUNDING ELECTRODE CONDUCTOR (GEC) BONDED TO REBAR

**PCC**

Pre-Cast Concrete Company

11400 Lang Street  
Anchorage, Ak, 99515  
PH (907) 348- 6730 FAX (907) 348-6734

PROJECT:

ALASKA DOT  
TS2 CONTROLLER CABINET FOUNDATION

CUSTOMER:

SENT BY:

DATE:

DRAWING NO.